


NCP 9750

Intumescent With TPE Fire and Smoke Seal



SEAL

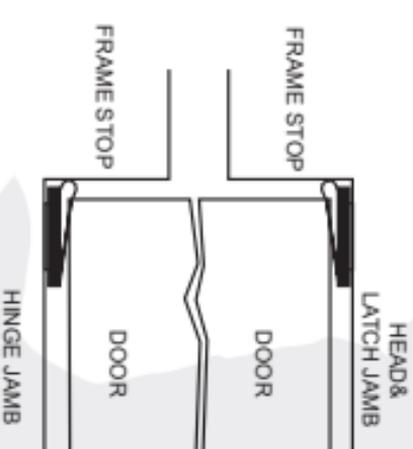

POSITIVE PRESSURE TESTED GASKETING MATERIALS FOR FIRE DOORS FOR APPLICATION TO HOLLOW-METAL-TYPE FIRE DOORS RATED UP TO 3 HOURS AND WOOD-TYPE FIRE DOORS RATED UP TO 1½ HOURS. CATEGORY C, H

SMOKE AND DRAFT CONTROL GASKETING (CATEGORY H) TESTED TO UL 1784; MEETS REQUIREMENTS OF NFPA 105, IBC FOR USE ON "S" LABEL DOORS.


- Self-Adhesive Intumescent
- Flame Resistant
- ½" Wide X ¾" Tall
- Available in 36", 48", 84", 96" and 108" Lengths

See ngp.com for All Applicable Certifications for this Product.

ngp.com
1-800-NCP-RUSH

INSTALLATION INSTRUCTIONS

9750

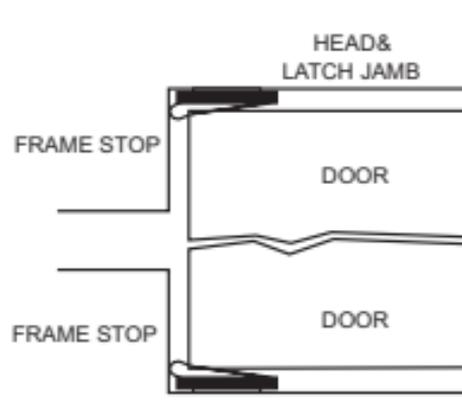

20, 45, 60, 90 Minute Rated Category
B Wood Doors Perimeter Application

Up To:

Single Swing 4'0 X 9'0

Pairs 8'0 X 9'0

UL Tested and Classified for
Fire and Smoke Doors.

* Seals against smoke, fire, air
and weather.

* Excellent compression; door
latches easily.

1. The surface temperature of the frame must be above 50°F for the adhesive to bond properly.
2. Clean frame with clean wipe provided to remove dust, oil, grease and dirt. Wax coated or high gloss painted surfaces may require roughening of the surface with a scotch brite pad or sandpaper so adhesive will properly bond.
3. Measure and pre-cut pieces to fit where seal is to mount. 1/8" clearance required between door and frame.
4. Remove protective backing 1 to 2 feet at a time.
5. Position on frame where illustrated.
6. Adhere by pressing firmly (approx. 15 lbs. pressure required) straight down along entire length of gasketing.
Do not remove and relocate.
7. Make sure the seal does not impede proper closing and latching of the door.



ngp.com

1-800-NGP-RUSH

FAX: (800) 255-7874

QUOTES: quotes@ngp.com

ORDERS: orders@ngp.com

MEMPHIS

4985 East Raines Road

Memphis, TN 38118

CARSON CITY

3689 Arrowhead Drive

Carson City, NV 89706